

# Neutronics assessment of different quench tank location options in IFMIF-DONES


Yuefeng Qiu, Frederik Arbeiter, Ulrich Fischer, Friedrich Gröschel, Kuo Tian

## Introduction

- IFMIF-DONES is a **DEMO** Oriented **NE**utron **S**ource based on the IFMIF engineering design (IFMIF/EVEDA). The Quench Tank (QT) is a caching container for buffering the high-speed Li-flow from the target assembly.
- Due to large size and important hydraulics function of QT, its location has strong impact on the test cell (TC) design. The hands-on maintenance must be allowed for the Li loop room after shutdown.

## Model and methodologies



- Option-1: QT located below the TC floor and connecting to the target with a long chute.
- Option-2: QT embedded in TC floor.

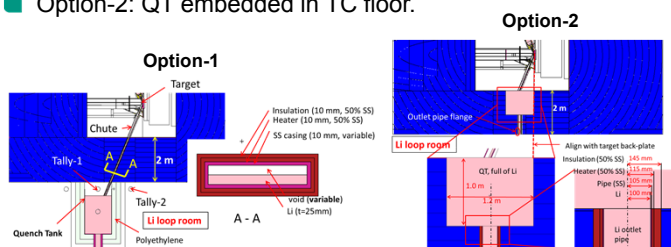



- Transport calculation: McDeLicious-11 and FENDL-3/SLIB4.
- Inventory calculation: FISPACT-07 and EAF-2007
- Shutdown dose rate: Rigorous two-step method code R2Smesh-2.1 developed at KIT.

## Inventory and shut-down dose



- Inventory calculation of QT (Option-1 with 15 mm void in the chute) and Li outlet pipe flange (Option-2).
- Shutdown dose rate calculation of Option-1 and Option-2. Li is drained out, and gamma source covers 0.5 m of the TC wall.



Contact dose rate of QT in Option-1 (left) and Li outlet flange in Option-2 (right)



Dose rate with (left) and without (right) in-TC components in Option-1




Dose rate with (left) and without (right) in-TC components


- The contact dose rate at critical positions and shutdown dose after one day cooling exceeds the hands-on limits (10 μSv/hr), thus hands-on maintenance is not possible in both QT location options.

## In-operation Analysis


- Parameter study of the Li-chute void-thickness (Option-1).

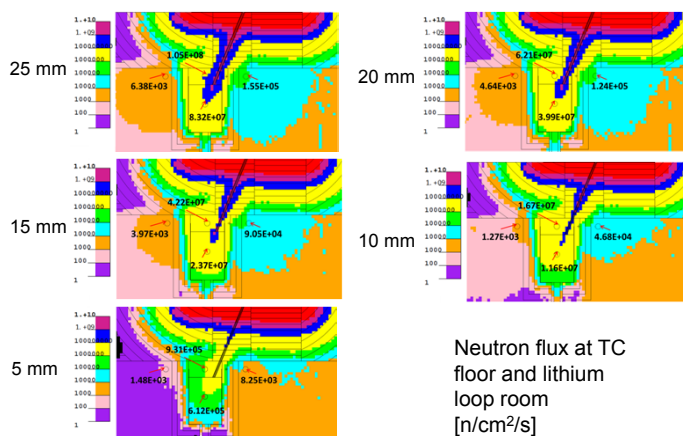

Neutron flux at TC floor and lithium loop room [n/cm²/s]



Neutron flux inside QT (Tally-1)



Neutron flux outside QT (Tally-2)

- A quasi-linear relation between void thickness and neutron flux are found inside and outside the QT.
- Decreasing the void thickness from 25 mm to 15 mm reduces ~50% of neutron flux inside QT, which is not so significant to reduce the QT activation.

## Conclusions

- Neutronics analysis have been carried out on IFMIF-DONES to evaluate the neutronics influence of QT in different locations.
- The relation between void thickness in the chute and neutron flux inside and outside the QT is quasi-linear.
- The results indicate that the Li room area is not possible for hands-on maintenance in both QT location options.